


ROWLAND WATER DISTRICT
INSTALLATION SPECIFICATION
FOR
DOUBLE DETECTOR CHECK
BACKFLOW PREVENTION ASSEMBLY

**ASSEMBLY TYPE AND LOCATION REQUIRES APPROVAL BY
ROWLAND WATER DISTRICT**



1. THE ASSEMBLY SHALL BE LOCATED AS CLOSE AS PRACTICAL TO THE PROPERTY LINE WITHIN CUSTOMER'S PROPERTY. ROWLAND WATER DISTRICT HAS JURISDICTION OVER PLACEMENT OF DCDA.
2. DISTRICT RECOMMENDS LOCKABLE ENCLOSURE TO DETER THEFT. ENCLOSURE MUST MEET CLEARANCE, ACCESS AND DRAINAGE REQUIREMENTS.
3. THERE SHALL BE NO VALVE, TAP, TEE OR SERVICE CONNECTION BETWEEN THE POINT OF CONNECTION AND THE ASSEMBLY.
4. MINIMUM OF 12" SIDE CLEARANCE FOR TEST COCKS.
5. MUST BE ACCESSIBLE FOR TESTING AND REPAIR.
6. THE ASSEMBLY MUST BE TESTED BY A CERTIFIED BACKFLOW PREVENTION TESTER WITHIN 30 DAYS OF THE INSTALL DATE AND ANNUALLY THEREAFTER.
7. ANY DEVIATION FROM THE METHOD DESCRIBED ABOVE MUST RECEIVE WRITTEN APPROVAL FROM THE

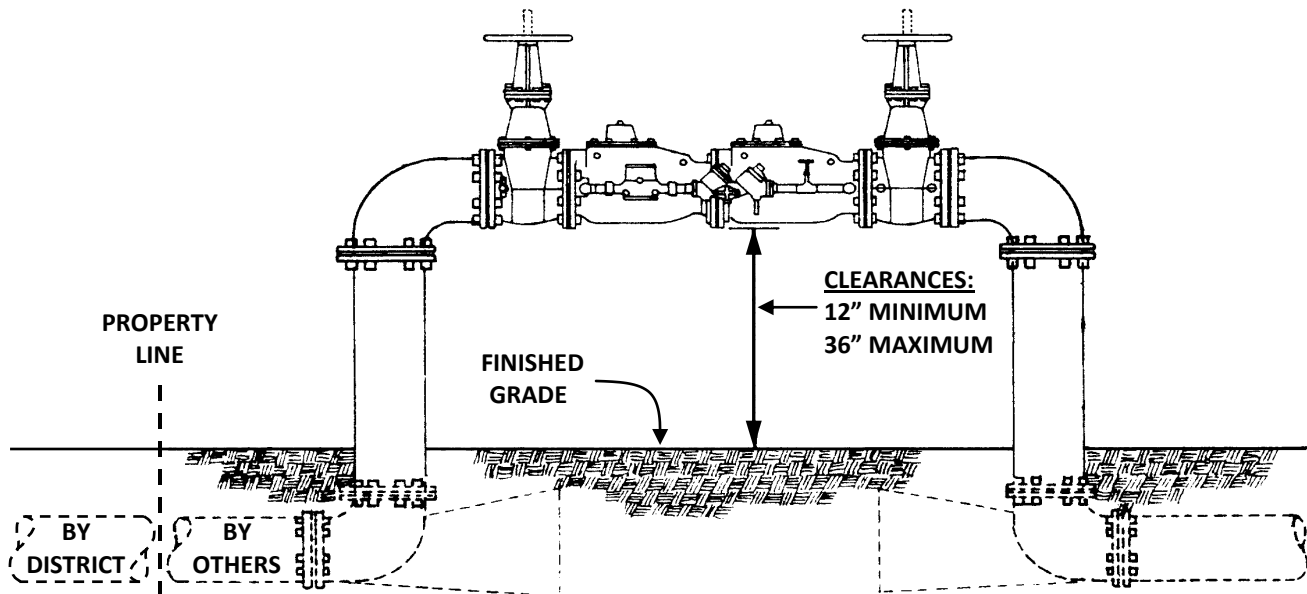